HAYWARD[®]

CAT 5500° Water Quality Controller

Owner's Manual



Contents

Introduction2
Installation4
Pool Chemistry7
Configuration7
SystemMaintenance24
Network Communications25
Troubleshooting29
Warranty34

CAT-5500

Hayward Pool Products 620 Division Street, Elizabeth NJ 07207 www.hayward.com

HAYWARD[®] IMPORTANT SAFETY INSTRUCTIONS

When using this electrical equipment, basic safety precautions should always be followed, including the following:

- READ AND FOLLOW ALL INSTRUCTIONS
- **WARNING:** Risk of Electric Shock. Connect controller only to a grounding type receptacle protected by a ground-fault circuit interrupter (GFI). CAT Controllers recommends installation to a dedicated GFI circuit breaker performed by a licensed electrician.
- **WARNING:** Disconnect power before servicing. Other than the fuses, there are no user serviceable parts inside the controller.
- **WARNING:** All power cords should be inspected frequently. Any damaged power cords must be replaced immediately to reduce the risk of electric shock. Never operate a controller without functional flow protection.
- **WARNING:** Installation requires a properly located GFI protected receptacle. Never use an extension cord for electrical connections to the controller.
- **WARNING:** Always mount controller in a safe area not subject to damage by moving objects. Never bury controller power cords.
- **WARNING:** Any person using, adjusting, or monitoring the controller must be at least 18 years of age and be familiar with these instructions and the contents of this manual.
- **WARNING:** Always take and record manual water chemistry readings in conformance with Health Department requirements. Although automated controllers are a great aid in maintaining healthy water quality, controllers are not a substitute for manual water testing with an accurate test kit.
- **WARNING:** Always read and become familiar with Material Safety Data Sheets (MSDS) and safe handling instructions for all chemicals used with the controller.
- **Caution:** The automatic controller should not be installed where it is accessible to the public.
- Overfeed Timers prevent potentially dangerous, unintentional dispensing of chemicals. CAT Controllers recommends always having the "Over Feed Timeout" functions enabled as a precautionary measure. By disabling the "Overfeed Timeout" the overfeeding of chemicals could occur and create unsafe water chemistry conditions. Overfeeding chemicals is dangerous and could potentially harm patrons.

Certification - NSF 50 Certified for ph/ORP Display and Output only

SAVE THESE INSTRUCTIONS




Description

The CAT 5500 revolutionizes the manner in which water quality can be monitored and maintained. A pool operator typically checks, records and adjusts pool or spa water chemistry hourly at best. The CAT 5500 continuously samples pH and sanitizer activity, adjusting the feeding of chemicals on a basis proportional to the demand. Hourly water quality readings are sent along with any alarms or service requests through a wireless network to the POOLCOMM web server for remote monitoring and management through any internet connection. *NOTE: The POOLCOMM website is a subscription based service. Monthly charges apply.*

From the website, the subscriber can monitor water quality, print charts, graphs and logs, change controller settings, and designate contacts for outbound notification via email, cell phone or PDA. Optional digital flow and level sensors are available to monitor flow rate, chemical storage tank levels, and even automate water level control.

The results include elimination of "human error", accurate and reliable maintenance of chemical levels twenty-four hours a day, compliance with Health Department operating standards, reduced burden on operating staff, and a reduction of chemical usage and costs. The CAT 5500 controller and POOLCOMM water quality management website together provide unprecedented control, access and documentation.

The following graph compares typical chlorine levels when chemistry is adjusted manually versus automatically with the CAT 5500 controller:

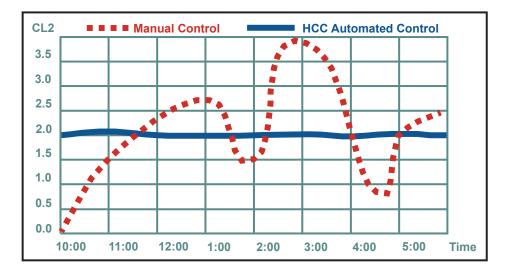



What's Included Description

The following is a description of the components incorporated in a typical CAT 5500 wireless water quality control system:

The Professional-Series pH Sensor samples water from the filtration system and sends signals to the controller indicating the acidity of the water. The ideal pH range for pools and spas is 7.4 - 7.6. The CAT 5500 controller is preset from the factory to maintain pH 7.5. If pH is maintained below 7.4 (too acidic), eye irritation, corrosion of equipment, and damage to the pool or spa surface can occur. If pH is maintained above 7.6 (too alkaline), sanitizer activity is reduced, water may become cloudy, and eye irritation may result.

The Professional-Series ORP Sensor samples water from the filtration system and sends signals to the controller indicating the oxidation-reduction potential (redox) of the water. ORP is an actual measure of sanitizer activity (chlorine, bromine, ozone, etc.) and bacteriological water quality rather than an expression of chemical residual levels. The CAT 5500 controller is preset from the factory to maintain ORP at 650 millivolts.

The Flow Sensor monitors the rate of flow across the pH and ORP sensors and signals the controller to disable automated chemical feeding during periods when the filtration system is off or low recirculation flow is detected.

The Flow Cell provides a convenient location for mounting the pH, ORP and Flow sensors while ensuring ideal hydraulic conditions to maximize sensor performance and life.

The CAT 5500 Controller scans and interprets the signals from the pH, ORP, flow, and optional digital flow-rate and level sensors, displays water quality readings and alarms in alphanumeric format, and activates chemical feeders in proportion to demand to maintain pH and ORP setpoint levels.

The controller incorporates audible and visual safeguard alarms for out of range conditions and menu-driven control of setpoints, alarms, and a host of advanced features. The CAT 5500 controller also features an internal transceiver for wireless transmission of data between the controller and POOLCOMM website.

The Level Sensors (optional) provide signals to the controller indicating low pH chemical tank level, low ORP tank level, and low water level.

The Digital Flow Sensor (optional) provides a flow rate to be displayed by the controller and an alarm indication when filter maintenance is required.

Package Contents:

- (1) CAT 5500 Wireless Water Quality Controller
- (1) PVC Backboard with Mounting Holes and Stainless Hardware
- (1) Professional Series pH Sensor with 24" Cable and BNC Connector
- (1) Professional Series ORP Sensor with 24" Cable and BNC Connector
- (2) Sensor Storage Containers
- (1) Injection Molded Flow Cell



- (3) 1/4" NPT x 3/8" Tubing True-Seal Ball Valve
- Flow Switch with 24" Čable and Specialty Connector (1)
- (1) (2) Temperature Sensor with 10' Cable and Specialty Connector
- BNC Connector Protective Covers (Remove to Connect Sensors)
- (1)30' Roll, Blue Poly Installation Tubing (3/8" OD)
- (2) 1/4" NPT x 3/8" Tubing True-Seal Connectors

NOTE: Before commencing installation, please confirm that items listed above have been included. Please report any shortages immediately to the factory.

What You Will Need

The following tools are recommended for installation:

Drill (Cordless preferred) 3/8" Drill Bit 1/4" NPT (National Pipe Tapered) Tap Masonry Drill Bit & Anchors (if required) 13/16" Wrench or Channel-Lock Pliers.

Installation

Installation Procedure

The key to a successful flow cell installation is in the plumbing. A pressure differential is required to allow clean, untreated water to pass through the cell and across the sensors. We recommend using the enclosed tubing and fittings to create a pressure-suction "loop" line.

Follow the directions below for installation and refer to the Installation Diagram on page 6.

- 1. Turn off heater, chemical feeders, pump, and any other related equipment. Relieve pressure from filtration system.
- 2. Select a convenient mounting location for the controller unit which will meet the following criteria.
 - Facilitates a combined (influent and effluent) maximum tubing run of 30'. a.
 - Located a minimum of ten feet from pool or spa. b.
 - GFI protected power source available. C.
 - d. Easily accessible to pool or spa operator.
 - Away from corrosive materials and physical hazards. e.
- 3. Securely mount PVC Backboard on vertical wall.
- 4. Drill and tap a 1/4" NPT port at a location just downstream of the filter, but upstream from any chemical injection point. Install a tubing connector, and run flex tubing to the influent flow cell port.
- 5. Drill and tap a 1/4" NPT port at a location subject to vacuum or reduced pressure. Install the remaining tubing connector and run flex tubing to the effluent flow cell port.



- 6. Cut a 3" length of flex tubing and insert into the sample stream port.
- 7. Remove pH and ORP sensors from the plastic storage bottles and save bottles and storage fluid for future use. Thread sensors into flow cell.
- 8. Remove BNC protective covers from left side of controller unit and store for future use. These covers protect the controller unit from electrostatic discharge (ESD) and should be used whenever handling or transporting the controller unit.
- 9. Connect the pH, ORP and Flow sensor cables to the controller unit as labeled. Sensor cables are constructed from a specialized material never cut or splice.
- 10. Drill and tap a 1/4" NPT port at the location from which temperature measurement is desired (upstream from heater). Insert temperature sensor and connect to controller.
- 11. If new or additional chemical feeders are to be used with the controller, install according to manufacturer's instructions at this time.
- 12. Connect chemical feeders to the controller as labeled (See diagram below).
- 13 Check all electrical and mechanical connections. Resume filtration system operation and check for any leaks.




Working with Tru-Seal Fluid Connections for a Fast, Professional Installation (See diagram below).

Body Collet	Prepare Tubing:	Insert Tubing	To Release Tubing:
0-Ring	burrs. Mark tubing	Insert tubing straight into fitting until it bottoms out and insertion mark is no longer visible.	Push collet toward fitting body and pull on tubing to release. Repeat steps 1 and 2 to reuse fitting.



Typical Cat 5500 Installation Diagram

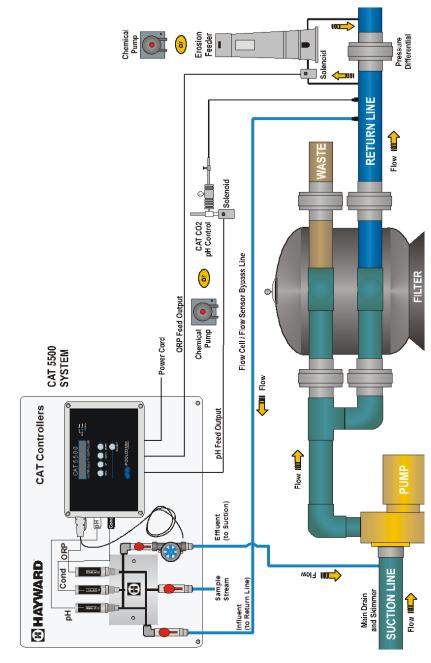

HAYWARD[®] Pool Chemistry

Now that your new controller has been physically installed, water chemistry should be tested and adjusted prior to initiating automated control of the pool or spa. Confirm that your pool or spa water conforms to the following ranges before powering on and setting up the CAT 5500.

The table below indicates generally accepted guidelines. Always maintain water chemistry according to standards set by your local or State Health Department.

Test	Minimum	Ideal	Maximum
рН	7.2	7.5	7.8
Free Chlorine (PPM)	1	2	3
Bromine (PPM)	2	3	4
Cyanuric Acid (PPM)	0	-	100
ORP (mV)	650	-	-
Total Alkalinity	80	-	120
Calcium Hardness	200	_	400

All CAT water quality controllers maintain sanitizer levels (chlorine, bromine, ozone, etc.) based on ORP. Although ORP is a superior index of water quality compared to part per million sanitizer residual levels, factors such as pH, cyanuric acid concentration and total dissolved solids can affect sanitizer residual readings relative to ORP.

CAT Controllers recommends establishing desired pH, sanitizer residual, calcium hardness, total alkalinity, temperature and cyanuric acid levels prior to initiating automated control of the pool or spa. The ORP setpoint will need to be changed periodically as described later in this section if the goal is to provide consistent sanitizer residual levels rather than consistent control of ORP.

Configuration

Overview

The CAT 5500 features a bright, menu-driven vacuum-fluorescent display which makes setup and programming simple in any lighting conditions. The menu structure is divided into two sections; the Operating Menu is intended for the end user to manage settings which are accessed on a frequent basis, while the Configuration Menu is used to set up advanced features which truly customize the controller to meet the individual requirements of the application.

The keypad provides intuitive access to the controller functionality as described on the following page.




MENU: Used to enter menu mode and to navigate back within the menu structure.

UP: Used to increase values and to navigate vertically up within the menu structure.

DOWN: Used to decrease values and to navigate down within the menu structure.

ENTER: Used to select or confirm a menu item.

TRANSMIT: Sends a Service Request alarm and current data to the POOLCOMM web server.



Basic Configuration Options Normal Operating Mode:

During normal operating mode, the display will indicate sensed pH, ORP, Flow Rate (with optional digital flow sensor) and a status line which alternates between:

- a) "System OK" or a list of any alarm conditions
- b) A graph indicating sensed pH and ORP vs- setpoint values.

The following is a typical display during normal operating mode:



To Change The Brightness Of The Display:

The display intensity can be changed to accommodate comfortable viewing in a variety of lighting circumstances. While in normal operating mode:

Press UP to increase display intensity. Press DOWN to decrease display intensity.



To Enter The Operating Menu:

The operating menu contains selections which are likely to be changed on a routine basis, and therefore are easily accessed. While in normal operating mode:

Press MENU. The following will be displayed:

Operating Menu pH Setpoint

To Change The pH Setpoint:

The CAT 5500 is programmed at the factory with a default setpoint of pH 7.5. CAT Controllers considers this to be ideal for pool and spa applications. The following steps enable the selection of a different setpoint. While in normal operating mode:

Press MENU. Select pH setpoint by pressing ENTER. The current pH setpoint will be displayed:




Press UP or DOWN to select the desired pH. Press ENTER to save your selection.

The controller will automatically return to normal operating mode in 10 seconds.

To Calibrate pH:

The CAT 5500 is far more accurate than most liquid test standards, but pH calibration is necessary to match manual water testing results, compensate for a depleted or unclean pH sensor, and confirm proper operation of the system. While in normal operating mode:

Press MENU. Press DOWN to find the pH Calibrate menu item. Press ENTER to select pH Calibrate. The sensed pH value as currently calibrated will be displayed:



Press UP or DOWN to match your known good standard. Press ENTER to save your selection.



To Select pH Feed Mode:

The CAT 5500 is programmed at the factory to operate in automatic feed mode as the default setting. Other pH feed mode selections include off (disabled), and manual on for a fixed interval up to 25 minutes after which automatic feed will resume. While in normal operating mode:

Press MENU. Press DOWN to find the pH Feed Mode menu item. Press ENTER to select pH Feed Mode. The current pH Feed Mode will be displayed:

pH Feed Mode Automatic Feed

Press UP or DOWN to find the desired selection. Press ENTER to save your selection.

The controller will automatically return to normal operating mode in 10 seconds.

The "Off" (disabled) mode is useful when servicing pH feed equipment, or if pH chemical supply has been depleted.

The "Manual On" mode allows constant chemical feed for a fixed interval of up to 25 minutes. This feature is useful when the addition of extra chemicals is desired, as well as during initial balancing of the water.

NOTE: Always disconnect chemical feeder power cords prior to performing any electrical service.

To Change The ORP Setpoint:

The CAT 5500 is programmed at the factory to maintain ORP at 650 mV by default. This is the generally accepted world standard for safe drinking water. In order to maintain a given chlorine or bromine residual in conformance with Health Department standards for a particular body of water, perform the following:

Check and balance pH, calcium hardness and total alkalinity. Manually feed chlorine or bromine to desired ppm residual. Note the displayed ORP value. This will be used as the setpoint. While in normal operating mode:

Press MENU. Press DOWN to find the ORP Setpoint menu item. Press ENTER to select ORP Setpoint. The current ORP setpoint will be displayed:



Press UP or DOWN to select the setpoint noted above. Press ENTER to save your selection.



To Select ORP Feed Mode:

The CAT 5500 is programmed at the factory to operate in automatic feed mode as the default setting. Other ORP feed mode selections include off (disabled), and manual on for a fixed interval up to 25 minutes after which automatic feed will resume. While in normal operating mode:

Press MENU. Press DOWN to find the ORP Feed Mode menu item. Press ENTER to select ORP Feed Mode. The current ORP Feed Mode will be displayed:

ORP Feed Mode Automatic Feed

Press UP or DOWN to find the desired selection. Press ENTER to save your selection.

The controller will automatically return to normal operating mode in 10 seconds.

The "Off" (disabled) mode is useful when servicing ORP feed equipment, or if sanitizer chemical supply has been depleted.

The "Manual On" mode allows constant chemical feed for a fixed interval of up to 25 minutes, useful when the addition of extra chemicals is desired, as well as initial balancing of the water.

Advanced Configuration Options To Enter The Configuration Setup Menu:

The configuration setup menu contains features which enable the CAT 5500 to be customized to the unique characteristics of the application. Optional accessories such as the digital flow meter are also activated through this menu. While in normal operating mode:

Press MENU. Press DOWN to find the Configuration Setup menu item. Press ENTER to select Configuration Setup. The Configuration Setup Menu will be displayed:

Configuration Setup pH Control Mode

Press DOWN to scroll through menu items. Press ENTER to make a selection. Press MENU to return to the Operating Menu.



To Change The pH Control Mode:

The CAT 5500 is programmed at the factory to operate in the acid feed mode by default (when pH exceeds setpoint, the pH chemical feeder is activated). If the sanitizer or other factors of the application cause the pH to decrease, base feed mode must be selected. From the Configuration Setup Menu:

Press DOWN to find the pH Control Mode menu item. Press ENTER to select pH Control Mode. The current pH Control Mode will be displayed:



Press UP or DOWN to select acid feed or base feed. Press ENTER to save your selection. Press MENU to return to the Operating Menu.

The controller will automatically return to normal operating mode in 10 seconds.

NOTE: In certain unusual applications, pH correction may be required in both acid feed and base feed modes. The third relay can be programmed as described later in this manual to accommodate this requirement.

pH Priority:

The CAT 5500 features a pH Priority setting which will inhibit ORP feed whenever pH is greater than .2 pH from the setpoint. This feature provides an important safeguard when sanitizers with a high pH (such as liquid chlorine) are used. From the Configuration Setup Menu:

Press DOWN to find the pH Priority menu item. Press ENTER to select pH Priority. The current pH Priority Mode will be displayed:



Press UP or DOWN to enable or disable pH Priority. Press ENTER to save your selection. Press MENU to return to the Operating Menu.



pH Feed:

The CAT 5500 by default uses a time-based proportional feed algorithm which enables the control of virtually any body of water without under-feeding or overshooting the setpoint. With some types of chemical feeders, however, it is beneficial to disable proportional feed and feed on a fixed basis. From the Configuration Setup Menu:

Press DOWN to find the pH Feed menu item. Press ENTER to select pH Feed. The current pH Feed setting will be displayed:



Press UP or DOWN to select Proportional or Fixed feed. Press ENTER to save your selection. Press MENU to return to the Operating Menu.

The controller will automatically return to normal operating mode in 10 seconds.

pH Low Alarm:

The pH Low Alarm inhibits pH feed, sounds audible and visual alarms, and sends a message to the POOLCOMM website during a low pH condition. From the Configuration Setup Menu:

Press DOWN to find the pH Low Alarm menu item. Press ENTER to select pH Low Alarm. The current pH Low Alarm Setting will be displayed:



Press UP or DOWN to scroll to the desired setting. Press ENTER to save your selection. Press MENU to return to the Operating Menu.

pH High Alarm:

The pH High Alarm inhibits pH feed, sounds audible and visual alarms, and sends a message to the POOLCOMM website during a high pH condition. From the Configuration Setup Menu:

Press DOWN to find the pH High Alarm menu item. Press ENTER to select pH High Alarm. The current pH High Alarm Setting will be displayed:



Press UP or DOWN to scroll to the desired setting. Press ENTER to save your selection. Press MENU to return to the Operating Menu.



pH Overfeed Timeout:

The pH Overfeed Timeout inhibits pH feed, sounds audible and visual alarms, and sends a message to the POOLCOMM website when the pH setpoint is not reached after feeding continuously for a selectable period of time. From the Configuration Setup Menu:

Press DOWN to find the pH Overfeed Timeout menu item. Press ENTER to select pH Overfeed Timeout. The current pH Overfeed Timeout Setting will be displayed:

pH Overfeed Timeout Off

Press UP or DOWN to scroll to the desired setting. Press ENTER to save your selection. Press MENU to return to the Operating Menu

NOTE: Overfeed Timers prevent potentially dangerous, unintentional dispensing of chemicals. CAT Controllers recommends always having the "Overfeed Timeout" functions enabled as a precautionary measure. By disabling the "Overfeed Timeout" the overfeeding of chemicals could occur and create unsafe water chemistry conditions. Overfeeding chemicals is dangerous and could potentially harm patrons.

ORP Feed:

The CAT 5500 by default uses a time-based proportional feed algorithm which enables the precise control of virtually any body of water. With some types of chemical feeders, however, it is beneficial to disable proportional feed and dispense chemicals on a fixed basis. From the Configuration Setup Menu:

Press DOWN to find the ORP Feed menu item. Press ENTER to select ORP Feed. The current ORP Feed setting will be displayed:



Press UP or DOWN to select Proportional or Fixed feed. Press ENTER to save your selection.



ORP Low Alarm:

The ORP Low Alarm inhibits ORP feed, sounds audible and visual alarms, and sends a message to the POOLCOMM website during a low ORP condition. From the Configuration Setup Menu:

Press DOWN to find the ORP Low Alarm menu item. Press ENTER to select ORP Low Alarm. The current ORP Low Alarm Setting will be displayed:



Press UP or DOWN to scroll to the desired setting. Press ENTER to save your selection.

ORP High Alarm:

The ORP High Alarm inhibits ORP feed, sounds audible and visual alarms, and sends a message to the POOLCOMM website during a high ORP condition. From the Configuration Setup Menu:

Press DOWN to find the ORP High Alarm menu item. Press ENTER to select ORP High Alarm. The current ORP High Alarm Setting will be displayed:

ORP High Alarm 900 mV

Press UP or DOWN to scroll to the desired setting. Press ENTER to save your selection.

ORP Overfeed Timeout:

The ORP Overfeed Timeout inhibits ORP feed, activates audible and visual alarms, and sends a message to the POOLCOMM website when the ORP setpoint is not reached after feeding continuously for a selectable period of time. From the Configuration Setup Menu:

Press DOWN to find the ORP Overfeed Timeout menu item. Press ENTER to select ORP Overfeed Timeout. The current ORP Overfeed Timeout Setting will be displayed:

ORP Overfeed Timeout Off

Press UP or DOWN to scroll to the desired setting. Press ENTER to save your selection.

NOTE: Overfeed Timers prevent potentially dangerous, unintentional, dispensing of chemicals. CAT Controllers recommends always having the "Overfeed Timeout" functions enabled as a precautionary measure. By disabling the "Overfeed Timeout" the overfeeding of chemicals could occur and create unsafe water chemistry conditions. Overfeeding chemicals is dangerous and could potentially harm patrons.



Auxiliary pH Setpoint:

The auxiliary relay can be programmed to provide acid or base feed pH correction, or to support supplemental pH control with a second setpoint. Once the setpoint is entered, go to Auxiliary Output Setup to assign the relay to the desired function. From the Configuration Setup Menu:

Press DOWN to find the Auxiliary pH Setpoint menu item. Press ENTER to select Auxiliary pH Setpoint. The current Auxiliary pH Setpoint will be displayed:



Press UP or DOWN to scroll to the desired setting. Press ENTER to save your selection.

Auxiliary ORP Setpoint:

The auxiliary relay can be programmed to support supplemental ORP control with a second setpoint, or dechlorination. Once the setpoint is entered, go to Auxiliary Output Setup to assign the relay to the desired function. From the Configuration Setup Menu:

Press DOWN to find the Auxiliary ORP Setpoint menu item. Press ENTER to select Auxiliary ORP Setpoint. The current Auxiliary ORP Setpoint will be displayed:

AUX ORP Setpoint 650 mV

Press UP or DOWN to scroll to the desired setting. Press ENTER to save your selection.

Salt High Alarm:

The Salt High Alarm sounds audible and visual alarms, and sends a message to the Poolcomm website during a high salt condition. It does not inhibit chemical feed. From the Configuration Setup Menu:

Press DOWN to find the Salt High Alarm Menu item. Press ENTER to select Salt High Alarm. The current Salt High Alarm setting will be displayed:

Salt High Alarm 5500 ppm

Press UP or Down to scroll to desired setting. Press ENTER to save your selection. Press MENU to return to Operating Menu.



Salt Low Alarm:

The Salt Low Alarm sounds audible and visual alarms, and sends a message to the Poolcomm website during a low salt condition. It does not inhibit chemical feed. From the Configuration Setup Menu:

Press DOWN to find the Salt Low Alarm Menu item. Press ENTER to select Salt Low Alarm. The current Salt Low Alarm setting will be displayed:

Salt Low Alarm 4500 ppm

Press UP or Down to scroll to desired setting. Press ENTER to save your selection. Press MENU to return to Operating Menu.

TDS High Alarm:

The TDŠ High Alarm sounds audible and visual alarms, and sends a message to the Poolcomm website during a high TDS condition. It does not inhibit chemical feed. From the Configuration Setup Menu:

Press DOWN to find the TDS High Alarm Menu item. Press ENTER to select TDS High Alarm. The current TDS High Alarm setting will be displayed:

TDS High Alarm 6600 ppm

Press UP or Down to scroll to desired setting. Press ENTER to save your selection. Press MENU to return to Operating Menu.

Alarm Setup:

The Alarm Setup allows the audible alarm to be disabled without interfering with any other safeguards or alerts to the POOLCOMM website. From the Configuration Setup Menu:

Press DOWN to find the Alarm Setup menu item. Press ENTER to select Alarm Setup. The current Alarm Setup option will be displayed:

Alarm Setup Audible and Visual

Press UP or DOWN to scroll to the desired setting. Press ENTER to save your selection



Auxiliary Output Setup:

The auxiliary relay can be programmed to provide any one of the following functions:

Remote Alarm pH Base Feed pH Acid Feed ORP Feed Up ORP Feed Down Level / Flow Sensor #1, #2 or #3 Timer On for Selectable Interval

From the Configuration Setup Menu:

Press DOWN to find the Auxiliary Output Setup menu item. Press ENTER to select Auxiliary Output Setup. The current Auxiliary Output selection will be displayed:

AUX Output Setup Disabled

Press UP or DOWN to scroll to the desired setting. Press ENTER to save your selection.

Level/Flow Sensor Input # 3 Setup:

The third Level/Flow Sensor input is provided to facilitate, digital flow monitoring water level control, other features using optional sensors. From the Configuration Setup Menu:

Press DOWN to find the Input 3 Setup menu item. Press ENTER to select Input 3 Setup. Press DOWN to view the following options:

> Disabled Digital Flow (ENTER to select pipe size). Level Sensor

Press ENTER to confirm the selection.

After 10 seconds, the controller will revert to the Configuration Setup Menu.

Temp. Compensation:

This is the percent conductivity affected per degrees C, which is used to compensate conductivity readings based on temperature of the water. This setting should remain the same unless otherwise deemed necessary for your specific body of water. The default value is 2.14%. From the Configuration Setup Menu:

Press DOWN to find the Temp. Compensation Menu item. Press ENTER to select Temp. Compensation. The current Temp. Compensation setting will be displayed:



Temp. Comp. Factor 2.14 %%/degC

Press UP or Down to scroll to desired setting. Press ENTER to save your selection. Press MENU to return to Operating Menu.

Probe Resistance:

Used to cancel resistance out from the measured conductivity from the probe/cable This feature is used only when using probes with significantly longer length cables then the standard (24" as standard). The default value is 28 ohms. From the Configuration Setup Menu:

Press DOWN to find the Probe Resistance Menu item. Press ENTER to select Probe Resistance. The current Probe Resistance setting will be displayed:

Probe Resistance 28 ohms

Press UP or Down to scroll to desired setting. Press ENTER to save your selection. Press MENU to return to Operating Menu.

TDS Offset from Std.:

Used to calibrate TDS to manual test readings The default value is 0. Please adjust the displayed value up or down until it matches the accurate manually tested reference reading. From the Configuration Setup Menu:

Press DOWN to find the TDS Offset from Std Menu item. Press ENTER to select TDS Offset from Std. The current TDS Factor setting will be displayed:

TDS Offset from Std. 0.00 ppm/uS (0)

Press UP or Down to scroll to desired setting. Press ENTER to save your selection. Press MENU to return to Operating Menu.

Salinity Factor:

Used to calibrate Salinity Factor to manual test readings. The default value is 0.98. The TDS Offset calibration must be completed prior to adjusting this setting. Please than adjust the displayed value up or down until it matches the accurate manually tested reference reading. From the Configuration Setup Menu:



Press DOWN to find the Salinity Factor Menu item. Press ENTER to select Salinity Factor. The current Salinity Factor setting will be displayed:

Salinity Factor 0.98 1/ppm (5978)

Press UP or Down to scroll to desired setting. Press ENTER to save your selection. Press MENU to return to Operating Menu.

Display System Information:

The Display System Info function is used to view firmware revision number and the system date and time as acquired from the wireless communications link. From the Configuration Setup Menu:

Press DOWN to find the Display System Info menu item. Press ENTER to select Display System Info. Press ENTER at the prompt to confirm the selection. The System Information will be displayed:

firmware version 1.8 07-12-05 13:22 (UTC)

After 10 seconds, the controller will revert to the Configuration Setup Menu.

Hard Reset:

The Hard Reset function performs a power-on reset without changing any user-modified menu items such as setpoints, alarms, pH calibration, etc. From the Configuration Setup Menu:

Press DOWN to find the Hard Reset menu item. Press ENTER to select Hard Reset. Press ENTER at the prompt to confirm the selection.

The CAT 5500 will reset and perform a diagnostic self-test:



After 10 seconds, the controller will revert to the Configuration Setup Menu.

Restore Factory Defaults:

The Restore Factory Defaults function erases all user-modified settings from memory and restores all factory default settings and values. From the Configuration Setup Menu:

Press DOWN to find the Restore Factory Def. menu item.

Press ENTER to select Restore Factory Def.

Press ENTER again at the following prompt:

HAYWARD[®]

Restore Factory Def. ENTER to Restore...

The display will go blank, and all default settings will be restored.

After 10 seconds, the controller will revert to the Normal Operating Mode.

Caution: all user modified settings including acid/base feed mode, alarms, setpoints, etc. must now be configured as described earlier in this manual.

Update FW via BL:

This feature is used to update firmware on the controller. Please contact Hayward Commercial at 301-838-4001 if you have firmware issues with your controller. From the Configuration Setup Menu:

Press DOWN to find the Update FW via BL Menu item.

Configuration Setup Update FW via BL

Demonstration Mode:

The Demo Mode enables the CAT 5500 to be used as a demonstration, training, or sales aid. All functions, menus, and settings of the controller are active except that pH is simulated at 7.5 and ORP is simulated at 650 mV. Therefore, no sensors are required when working with the controller in Demo Mode. From the Configuration Setup Menu:

Press DOWN to find the Demo menu item. Press ENTER to select Demo. The current status of Demo Mode will be displayed:



Press UP or DOWN to make a selection. Press ENTER to save your selection. The controller will revert to the Configuration Setup Menu.


As a reminder that the controller is in Demonstration Mode, the following screen will be alternately displayed when in Normal Operating Mode:




Caution: Demonstration Mode must never be used when the CAT 5500 is connected to active chemical feeders or otherwise in use as a water quality controller. The CAT 5500 is simulating pH and ORP values, and therefore is not sampling the sensors or monitoring water quality.

HAYWARD[®]

CAT 5500 Menu Tree

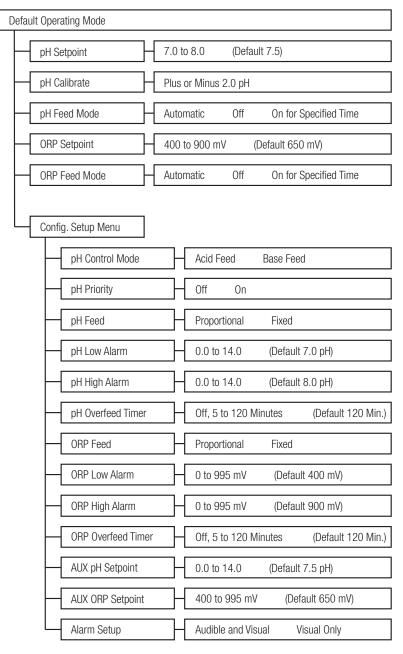



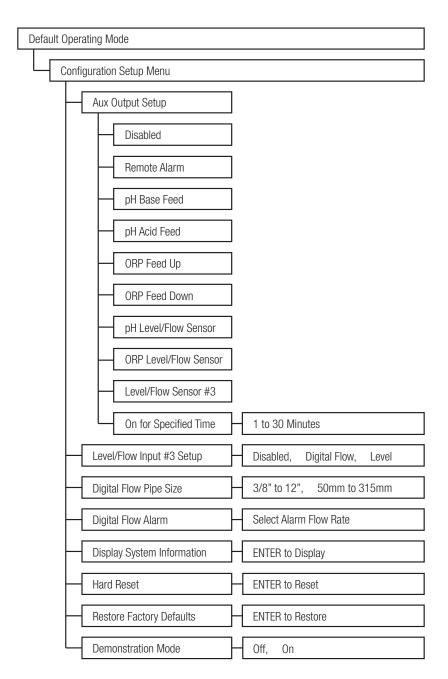



System Maintenance

Cat 5500 Controller Package

The CAT 5500 controller unit is virtually maintenance free. Cleaning of the enclosure, front panel and flow cell can be performed using a clean, soft cloth moistened with mild soap and water solution or glass cleaner. Use of abrasives or harsh chemicals may damage the enclosure and membrane switch panel.

Water Maintenance

Always test and record water chemistry readings in compliance with Health Department requirements using a quality manual test kit. Calibrate pH periodically as described earlier in this manual.

It is important to note that changes in pH, cyanuric acid concentration, total dissolved solids, and use of additional or alternative sanitizers will all affect the primary sanitizer residual level relative to ORP. It is important to maintain total alkalinity on a regular basis to ensure pH stability. To maintain a consistent sanitizer residual in parts-per-million (ppm), periodically adjust the ORP setpoint.

Precision Calibration

The CAT 5500 controller provides instrument-grade accuracy which exceeds that of most liquidstandard water testing kits. Therefore, it may be preferable to calibrate pH using commercially available reference solutions.

Sensor Maintenance

The sensors must be clean and free from oil, chemical deposits and contamination to function properly. After saturation in pool or spa water, the sensors may need to be cleaned on a weekly or monthly basis depending on bather load and other facility- specific characteristics. Slow response, increased need to calibrate pH, and inconsistent readings are indications that the sensors are in need of cleaning.

To clean the sensors, disconnect from the controller and carefully remove them from the flow cell. Clean the reference junction (the white teflon ring at the bottom of sensor body) with a soft tooth brush and regular tooth paste. A household liquid dishwashing detergent may also be used to remove any oil. Rinse with fresh water, replace teflon thread-seal tape, and reinstall sensors.

Sensor Replacement

CAT Professional Series pH and ORP sensors are engineered to provide the highest performance and longest possible functional service life. If properly cleaned, sensors provide unstable readings or require excessive calibration, the pair of sensors should be replaced. For optimum controller performance, replace with genuine CAT Professional Series sensors PR015-2 and PR025-2.

Sensor Storage

Exposure to atmospheric conditions will cause the sensor tips to dry out. Always remove and properly store sensors in the soaking caps provided if sensors are to be removed or stored for one hour or longer. Although CAT Professional Series sensors are freeze-resistant, they must be protected from freezing temperatures when not in use.

Store sensors in the soaking caps provided, making sure that each container is filled with the origi-



nal storage solution or clean water. If the storage containers have been misplaced, store sensors individually in small glass or plastic containers with clean water covering sensor tips.

Controller Storage

The controller unit is subject to damage by electro-static discharge (ESD) when the sensor cables are disconnected. Always reinstall the BNC protective covers prior to storing or transporting the CAT 5500 controller unit.

Winterization

The sensors should be prepared for storage as outlined above and protected from freezing temperatures. Although the CAT 5500 controller is designed to withstand a broad temperature range, winter storage in a secure location may be desirable.

The flow cell and poly tubing must be drained prior to exposure to freezing temperatures. Either purge all water using compressed air or thoroughly drain through the valve ports and tubing connections.

Network Communications

Testing for Network Coverage

Check the Coverage Map

CAT can provide a printed or electronic copy of the Reflex coverage map in your state. Please contact the POOLCOMM Program Administrator.

Check the Web Site

Visit the Sky-Tel web site and enter the exact address of the facility to be monitored. The web site will pinpoint that address on a custom coverage map. Start by entering www.skytel.com into your web browser. Next, select Telemetry then Coverage and enter the address to check, select locate. The CAT 5500 requires full service (Shown as Yellow) to send and receive data. Direct Link = www.skytel.com/coverage/telemetry_coverage.htm

Test with a Portable Reflex Device

The Reflex network can be tested with any number of portable 2-way messaging devices, such as: Skywriter, Blackberry, or any 2-way pager. To learn more or to purchase one of these devices visit www.skytel.com. Portable 2-way devices operate at about half the broadcast power output of the CAT 5500. Therefore, if you portable device has full service the CAT 5500 will definitely work well in that location. However, the CAT 5500 will communicate in locations a portable does not.

Test w/ a CAT 5500

The best way to check for Reflex coverage at a facility is to test with an actual CAT 5500. The Transmit data button has been provided specifically for this purpose. Place the CAT 5500 unit where you expect to install it and press the transmit data button. Within 2 minutes a service request alarm will be generated. This alarm will show up at the POOLCOMM web site, and can also be directed to your cell phone or portable 2-way device. Make sure your email address has been entered under Notifications and that address box is checked on the unit management page.



Secondary Carrier

If you find your client location does not have Skytel coverage contact the POOLCOMM Program Manager for secondary carrier availability.

Activating Communications

To activate your first CAT 5500 wireless controller on the POOLCOMM web site you must first register an account. Call 800-657-2287 and ask for the POOLCOMM Program Administrator if you need assistance.

Visit www.poolcomm.com from any internet-connected computer. Click on Register Account and complete all requested account information. Click on Register Account again to register with the system.

The next screen will then inform you that your account has been created and an email has been sent to you with your username and password. You may now log in to your account by typing your username and password, then clicking on the Login icon.

The Register Account Unit screen will now appear. Enter the requested information and click on Register Unit to begin accessing your CAT 5500 over the internet.





Using The POOLCOMM Website

Browse to www.poolcomm.com. At the Login screen type your username and password, then click on Login. This will bring up the Account Unit Management Screen, which allows you to view all of your communicating units:



Status Symbol

The status symbol indicates the 24 hour alarm status of individual controllers. Blue: No warning during the past 24 hours. Yellow: A warning condition has been corrected during the past 24 hours. Red: A warning condition currently exists.

Facility Name

This field provides a list of facilities automated with CAT 5500 wireless controllers. Click on a facility name to enter the Unit Profile for the controller. From the Unit Profile, the following settings can be modified online:


Facility name, location and time zone information. pH and ORP setpoint values. pH, ORP, tank level, flow and service key alarm settings. Alarm time delays for nuisance alarm filtering. Warning notification contacts for facility.

When the desired settings have been entered through the web interface, click the Update link to sent the settings to the CAT 5500 controller.

HAYWARD

To update the website with the latest data from the CAT 5500, click the Get Data link at the bottom of the page.

The following screen capture shows the settings which can be modified from the Unit Profile screen:

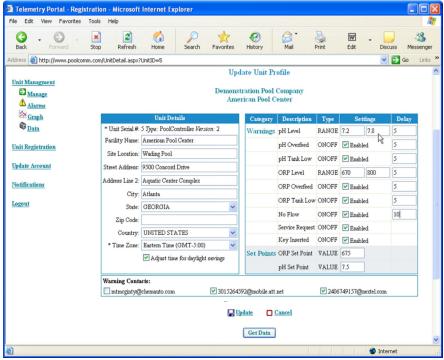

Site Location

This field is used to identify the specific asset being monitored (main pool, lap pool, spa, etc.) within the facility.

Last Warning

This field provides a timestamp of the last warning received.

Commands:

Manage This icon opens the Unit Profile page (shown above).



This icon opens the Unit Warning Alarms page.



This icon opens the Unit Data Graph page.

n Data

This icon opens the Unit Data Report screen.

HAYWARD[®]

Notifications to Cell Phones

The POOLCOMM website can provide email alerts through every major cell phone provider. You can set up your Poolcomm account to alert you with a text message any time an alarm is activated at one of your CAT 5500 locations. Just follow each company's e-mail to text message instructions.

AT&T

Your cell phone's e-mail address: 10-digit cell phone number@mobile.att.net Motorola's MX2000 and T721, Samsung's V206, and Panasonic's GU87 are all text message compatible.

Verizon Wireless

Your cell phone's e-mail address: 10-digit cell phone number@vtext.com All phones are text message compatible.

Sprint PCS

Your cell phone's e-mail address: 10-digit cell phone number@sprintpcs.com The PCS Vision Plan will allow your cell phone to receive text messages. All phones are text message compatible.

Nextel Communications

Your cell phone's e-mail address: 10-digit phone number@messaging.nextel.com All phones are text message compatible.

T-Mobile

Your cell phone's e-mail address: 10-digit cell phone number@tmomail.net All phones are text message compatible.

Cingular Wireless

Your cell phone's e-mail address: 10-digit cell phone number@mobile.mycingular.com All phones are text message compatible.

Cellular One

Your cell Phones e-mail address: 10-digit cell phone number.mobile@celloneusa.com All phones are text message compatible.

Troubleshooting

pH Out Of Range

pH is measured on a scale ranging from 0 to 14, with pH 7.0 considered neutral. pH below 7.0 is considered acidic and above 7.0 is alkaline. pH is a significant variable in determining water quality as it affects sanitizer activity, color, and human compatibility with the water. The proper pH range for swimming pools and spas is between 7.2 and 7.8.

pH Low

A pH below 7.2 will cause corrosive water resulting in possible damage to the filtration components and pool surface as well as bather discomfort. First, test the pool/spa water with a phenol red pH test kit. If the pH on the test kit agrees with the controller and the pH is below 7.2, check the pH correction chemical level. If the manual test does not agree with the controller clean the sensor.



pH High

A pH above 7.8 will cause scaling on the pool surface, plumbing, and filtration equipment as well as cloudy water, inefficient use of sanitizer and bather discomfort. First, test the pool/spa water with a phenol red pH test kit. If the pH on the test kit agrees with the controller and the pH is above 7.8, check the pH correction chemical level. If the manual test does not agree with the controller clean the sensor.

pH Overfeed

The pH Overfeed timeout occurs when the CAT 5500 has been feeding chemicals for a time greater than the selected maximum feed time and has not reached its setpoint. A properly selected Overfeed timeout prevents the unit from continuing to feed chemicals when the chemical supply has been diminished or a chemical feeder has become clogged or broken. First, check the chemical supply and chemical feeder. If both are in order, check the Overfeed timeout setting as it may need to be increased to keep up with chemical demand.

pH Tank Low

The pH Tank Low alarm will sound when the chemical being fed falls below the optional optical level sensor in the tank. First check the chemical level. If the level is above the sensor, check the sensor for obstruction or scaling.

ORP Out Of Range

Oxidation Reduction Potential is a measure of the oxidizing capacity present in water. Unlike a DPD chlorine reading, which can only differentiate between free available chlorine and the less effective combined chlorine, ORP provides an accurate measure of water quality regardless of pH, TDS, cyanuric acid, or non- chlorine oxidizers. The proper ORP range for swimming pools and spas is between 650 and 800 mV, with any value above 650 resulting in healthy water quality.

ORP Overfeed

The ORP Overfeed timeout occurs when the CAT 5500 has been feeding chemicals for a time greater than the selected maximum feed time and has not reached its set point. A properly selected Overfeed timeout prevents the unit from continuing to feed chemicals when the chemical supply has been diminished or a chemical feeder has become clogged or broken. First, check the chemical supply and chemical feeder. If both are in order check the Overfeed timer setting as it may need to be increased to keep up with chemical demand.

ORP Tank Low

The ORP Tank Low alarm will sound when the chemical being fed falls below the chemical level in the tank. First check the chemical level. If the level is above the sensor, check the sensor for obstruction or calcification.

No Flow

The CAT 5500 is equipped with a flow sensor to prevent the controller from feeding chemicals in the absence of proper recirculation. First check the filtration system to ensure that it is running and that water is moving through the flow cell. If water is flowing and the alarm is still sounding check flow sensor for obstruction.

When using the optional Digital Flow Sensor, the digital flow alarm setting can be entered in gallons-per-minute to send a No Flow alarm when the filters require cleaning or backwashing.



Service Request The Transmit button on the CAT 5500 sends logged data to the PoolComm web site for immediate viewing and generates a service request alarm.

Key Inserted

When a service technician visits the CAT 5500 he may insert a service key (optional), which will be logged by the controller to document the time and duration of his visit.

Technical Specifications

Enclosure Type Enclosure Properties Flame Resistance Display Front Panel Key Type	7" x 7" x 2.3" Glass Filled Polycarbonate NEMA Type 1, 4, 4X, 6, 12, 13 UL94-5V (UL 746 C 5) 2 x 20 Character Vacuum Fluorescent UV Protected Lexan Membrane Switch Embossed with Stainless Tactile Domes
Flow Cell Flow Sensor Backboard	Injection Molded with Integral Baffles Magnetic with Embedded Reed Switch CNC Machined & Beveled PVC
Inputs	CAT Professional Series pH Sensor CAT Professional Series ORP Sensor CAT Magnetic Flow Sensor CAT Rotary Flow Sensor Optical pH Tank Level Sensor Optical ORP Tank Level Sensor Optical Water Level Sensor Digital Flow Meter
Outputs	pH Feed, 4 Amp, 115 VAC ORP Feed 4 Amp, 115 VAC Dry Contact, 1 Amp Max
Auxiliary Output	User Programmable Remote Alarm pH Acid Feed pH Base Feed ORP Primary Feed ORP Supplemental Feed Dechlorination Control Level/Flow Sensor # 1 Level/Flow Sensor # 2 Level/Flow Sensor # 3 Time-based Activation



Communications Internet URL Latency Alarm Format	Bi-directional Wireless http://www.poolcomm.com < 2 Minutes per Path Email, Text Message, Internet
Safety Systems	pH Low and High Alarms ORP Low and High Alarms pH Priority Feed pH Overfeed Timeout ORP Overfeed Timeout Supplemental Feed Modes
Optional Equipment	Optical Level Sensors Digital Flow Rate Sensor Rotary Flow Sensor Remote Dome Antenna
Sensor Output Signal Requirements	0-14 pH, 0-1000mV ORP

HAYWARD[®]


Addendum for UL Listed Models

CAT 5500 - Revision I Terminal Block Wiring Instructions

The CAT 5500 UL listed controller must be installed in conformance with local and national electrical codes using hard-wired electrical connections. Please refer to the instructions below:

- 1. Disconnect power at circuit breaker.
- 2. Unscrew and remove the CAT 5500 cover to access the wiring terminal block.
- 3. Install UL listed ½" conduit and liquid-tight connectors for line, powered pH feed, and powered CL/BR feed.
- 4. Connect the CAT 5500 controller and powered outputs as shown in the wiring diagram below, using 18 gauge solid copper wire.
- 5. Reinstall the CAT 5500 cover, power on the controller, and test for proper operation of powered output devices.

Note: CAT Controllers recommends connecting the CAT 5500 controller to a dedicated 15 Amp

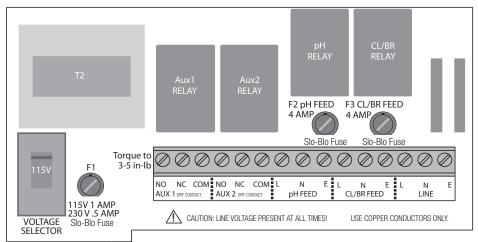

Terminal Block Wiring Diagram



WARRANTY

Hayward[®] warrants the CAT 5500 automated controller to be free of defects in material and workmanship for a period of five years from date of shipment from our factory or authorized distributor. Liability under this warranty is limited to the repair or replacement of any device or component which is returned to the factory within five years of delivery to original purchaser, shipping prepaid, and which is found to be defective upon examination.

Hayward[®] warrants all sensors, flow switches, fittings and accessories to be free of defects in material and workmanship for a period of one year from date of shipment from our factory or authorized distributor. Liability under this warranty is limited to the repair or replacement of any device or component which is returned to the factory within one year of delivery to original purchaser, shipping prepaid, and which is found to be defective upon examination.

Hayward[®] disclaims all liability for damage during transportation, for consequential damage of whatever nature, for damage due to handling, improper installation or operation, and for determining suitability for the use intended by the purchaser.

Hayward[®] makes no warranties, either expressed or implied, other than those stated above. No representative has authority to change or modify this warranty in any respect. After obtaining a Return Merchandise Authorization form, any warranty claims should be directed to the following address:

Hayward Commercial Pool Products 10101 Molecular Drive Suite 200 Rockville, MD 20850 (USA) 800-657-2287 301-838-4001

For further information or consumer technical support, visit our website at **www.hayward.com**





CONTENTS COPYRIGHT 2015 HAYWARD INDUSTRIES, INC. ALL RIGHTS RESERVED

All other trademarks not owned by Hayward are the property of their respective owners. Hayward is not in any way affiliated with or endorsed by those third parties.